


CONTROL PANEL WITH 3Ø POWER SUPPLY FROM CONTROL TRANSFORMER IN COMPRESSOR MOTOR STARTER, SYSTEM PRESSURE INDICATING LIGHT, GFI CIRCUIT BREAKER, SPARGER SELECTION SWITCHES WITH PILOT LIGHTS, GFI RECEPTACLE & 120/24V CONTROL TRANSFORMER FOR POWER TO START/STOP HAND CONTROLLER.

**NOTE:**  
CONTROL PANEL TO BE LOCATED IN WALL OR POST CLOSE TO COACHING POSITION.

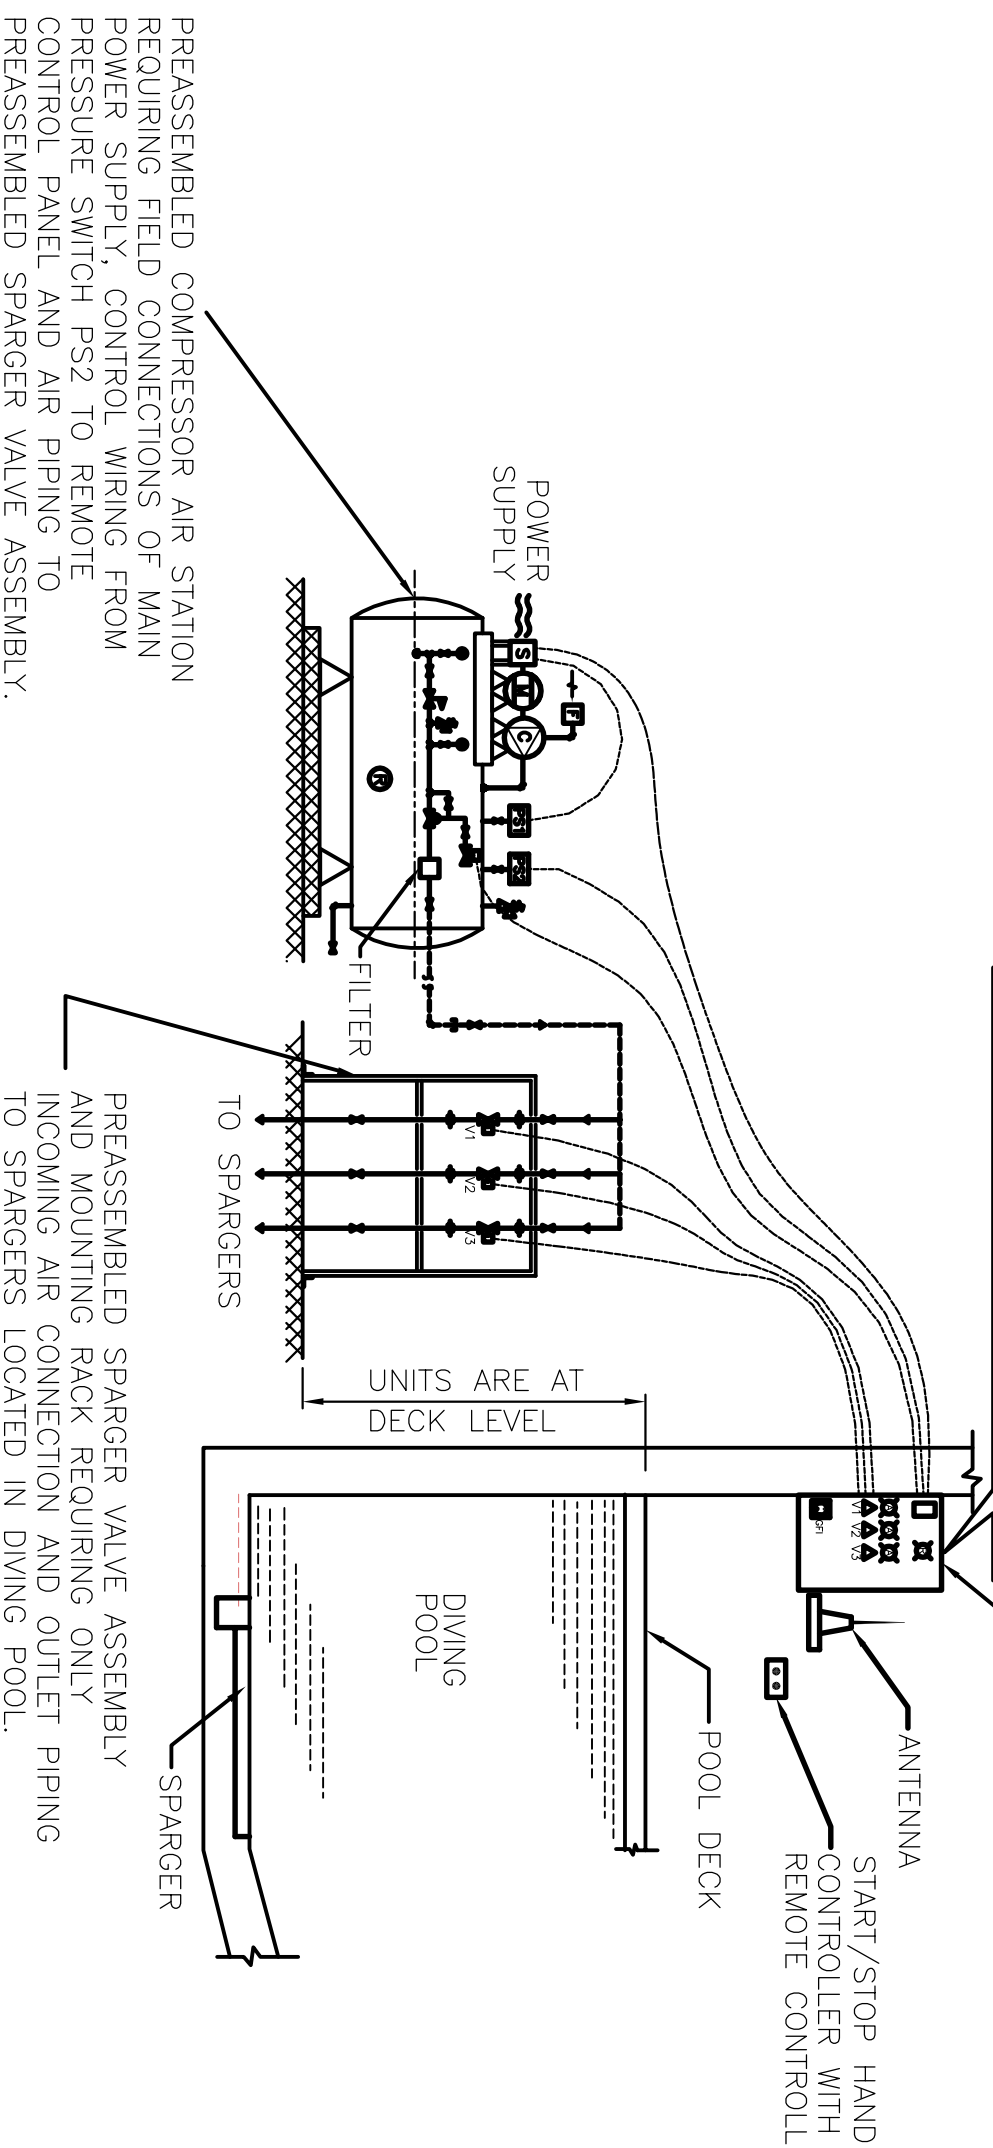

### LEGEND

- ③ AIR COMPRESSOR
- ① MOTOR
- ② MOTOR STARTER WITH CONTROL TRANSFORMER
- ④ AIR INTAKE FILTER
- ⑤ AIR RECEIVER
- ⑥ PRESSURE SWITCH TO CYCLE COMPRESSOR
- ⑦ PRESSURE SWITCH FOR INDICATING LIGHT IN CONTROL PANEL

- PRESSURE REDUCING VALVE
- QUICK – OPENING VALVE AIR OPERATED WITH CONTROL SOLENOID VENT VALVE
- SOLENOID CONTROL VALVE (MAV)
- PRESSURE RELIEF VALVE
- MANUAL SHUTOFF VALVE
- CHECK VALVE
- PRESSURE GAUGE

- PREASSEMBLED AIR PIPING
- - - FIELD PIPING BY CONTRACTOR
- ⊕ PIPE UNION
- ⊙ PIPE COUPLING
- ~ FACTORY WIRING
- ~ FIELD WIRING
- ▶ DIRECTION OF FLOW



TECHNICAL DATA	
Technology	
Dimension	54X25 H.140-300
Perimeter (m)	
Surface (m²)	Volume (m³)

PROJECT	
Ft. McMURRAY BUBBLER SYSTEM	
54 M POOL	
Drawing	
Revision	Scale Checked

DRAWING	
Drawing Number	MP16-1234-B
Date	AUG-01-08
Project Leader	BRESCIANI C.
Drawn	

REVISIONS	
① Date:	Issued for:
② Date:	Issued for:
③ Date:	Issued for:
④ Date:	Issued for:
⑤ Date:	Issued for:
⑥ Date:	Issued for:
⑦ Date:	Issued for:
⑧ Date:	Issued for:
⑨ Date:	Issued for:
⑩ Date:	Issued for:

**Myrtha pools**  
 Divisione commerciale della A&T EUROPE SPA  
 46043 Castiglione delle Stiviere (Mn)  
 TEL. 0376-94261  
 FAX 0376-631482  
 E-mail: info@myrthapools.com  
 Info@ischiacastiglione.it